
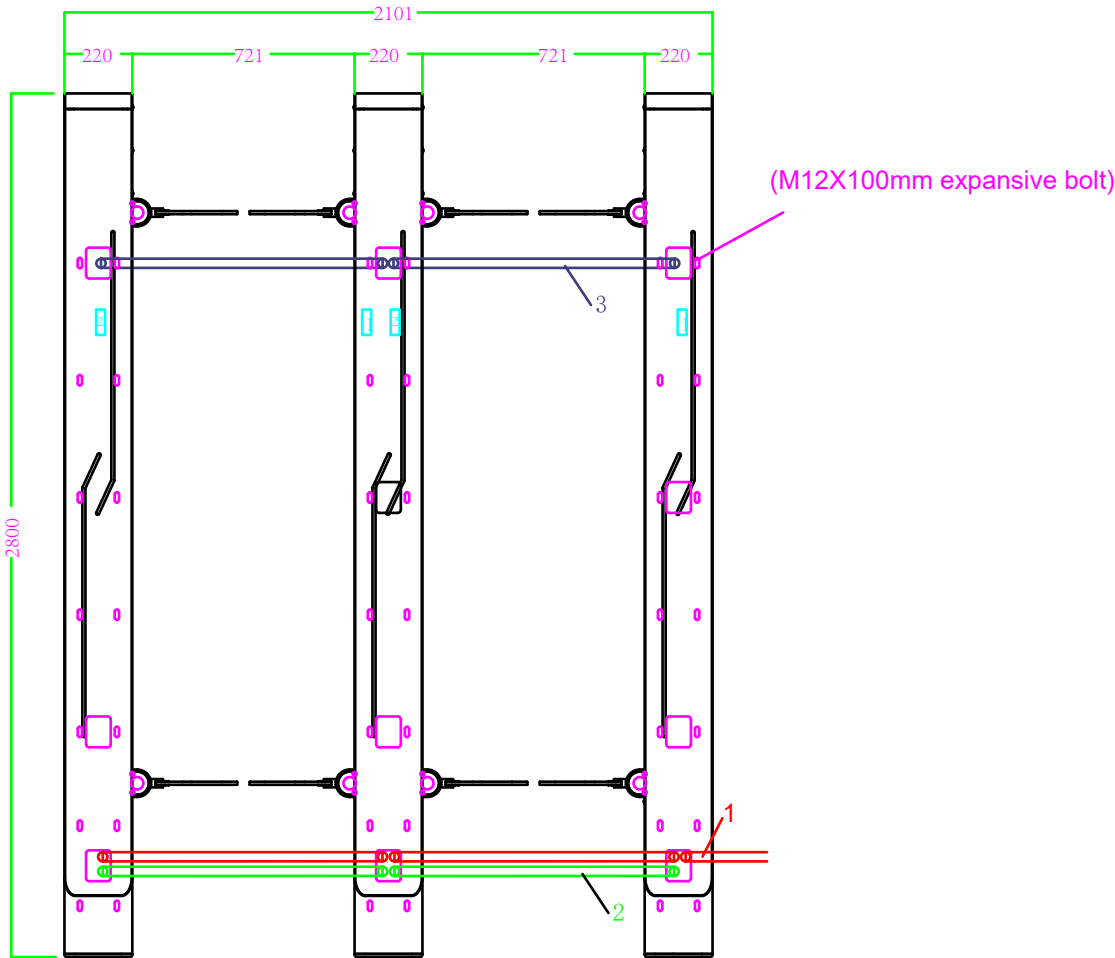
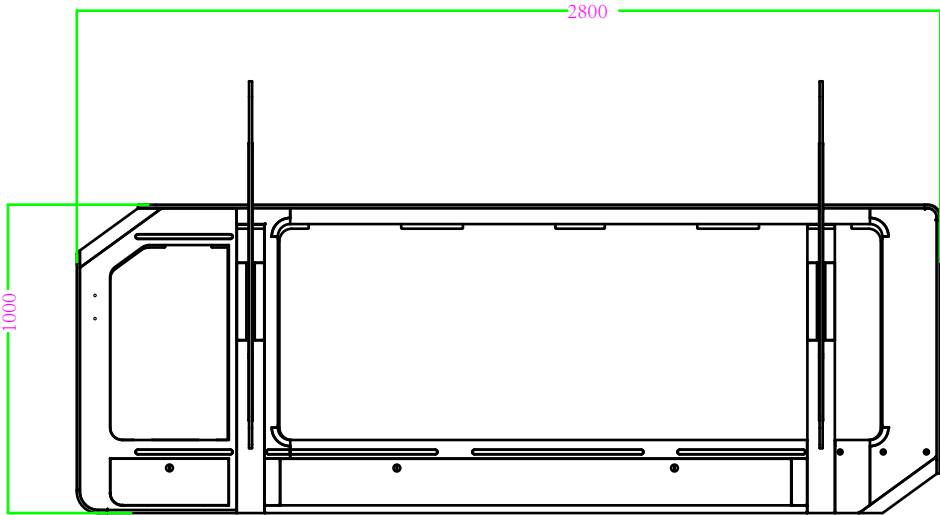


Unit:mm

V1.7

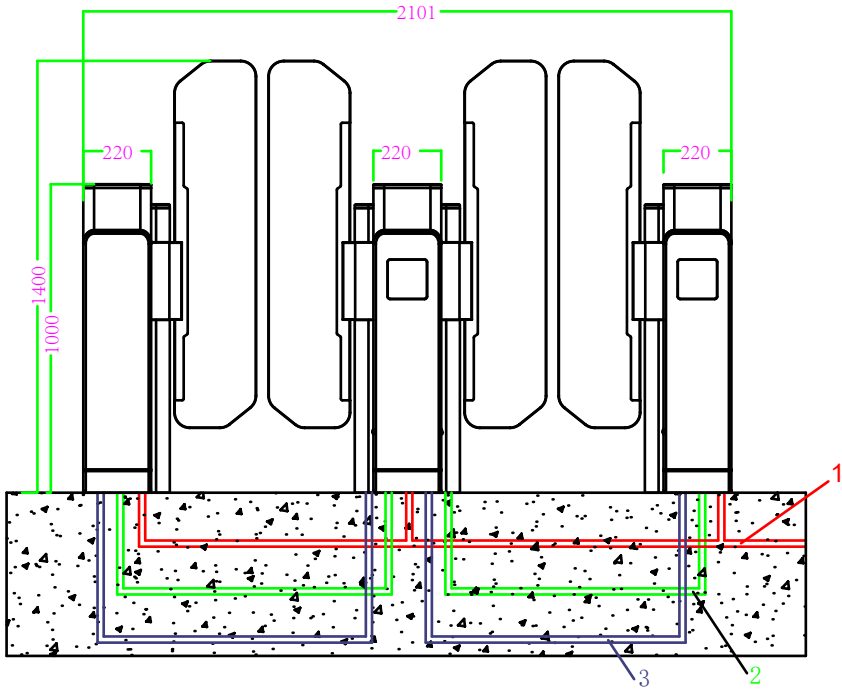

Installation Manual:

- 1 The Ø20mm PVC tube for AC 220V Power wires(3 X Ø2.0mm).
- 2 A gate online cable (super five eight-core network cable \*3, 2-core \*1.0mm power cable \*1, each channel between the host and the auxiliary equipment)
- 3 B gate online cable (super five eight-core network cable \*3, 2-core \*1.0mm power cable \*1, each channel between the host and the auxiliary equipment)
- 4 1 is the main driver of the gate, 2 is the secondary driver of the gate
- 5 Fixing the equipment with M12 X 100mm expansive bolt .

Mark:All wires extending out of the ground shall be no less than 2M.